

| No. | NAME | DESCRIPTION | Q' TY |
|-----|----------|--|-------|
| 1 | WIRE | UL1007#20 C=RED, BLACK L=215mm | 5/6 |
| 2 | WIRE | UL1007#20 C=BLACK L=55mm | 1 |
| 3 | TERMINAL | R2663-D3-F-BT | 11 |
| 4 | HOUSING | R2660-D3-12M PH:3.0mm 2x6P | 1 |
| 5 | TERMINAL | R2663-M-BT-L | 13 |
| 6 | HOUSING | R2660-24F PH:4.20mm 2x12P WITH MOUNTING EARS | 1 |


PIN OUT

| | P1 | P2 |
|-------|----|----|
| RED | 1 | 4 |
| RED | 2 | 6 |
| RED | 4 | 21 |
| RED | 5 | 22 |
| RED | 6 | 23 |
| BLACK | 7 | 3 |
| BLACK | 8 | 15 |
| BLACK | 9 | 5 |
| BLACK | 10 | 18 |
| BLACK | 11 | 7 |
| BLACK | 12 | 19 |

16 BLACK
 17 BLACK



| DWG NAME | RE011-1022-6309 (RoHS) | CHECKED | APPROVED | SCALE: NTS | REV NO | DATE | DESCRIPTION | BY | CHECKED | WORKING STATION |
|----------|------------------------|------------|------------|-----------------|--------|------------|---------------------|-----|---------|-----------------|
| | | PIQI | | UNIT: mm(in.) | A | 2008.07.08 | REL | YXF | | |
| | | DRAWN NAME | DATE | CAD NO | B | 2008.09.02 | CHANGE HOUSING SPEC | YXF | | |
| | | YXF | 2008.07.08 | RE011-1022-6309 | C | | | | | |

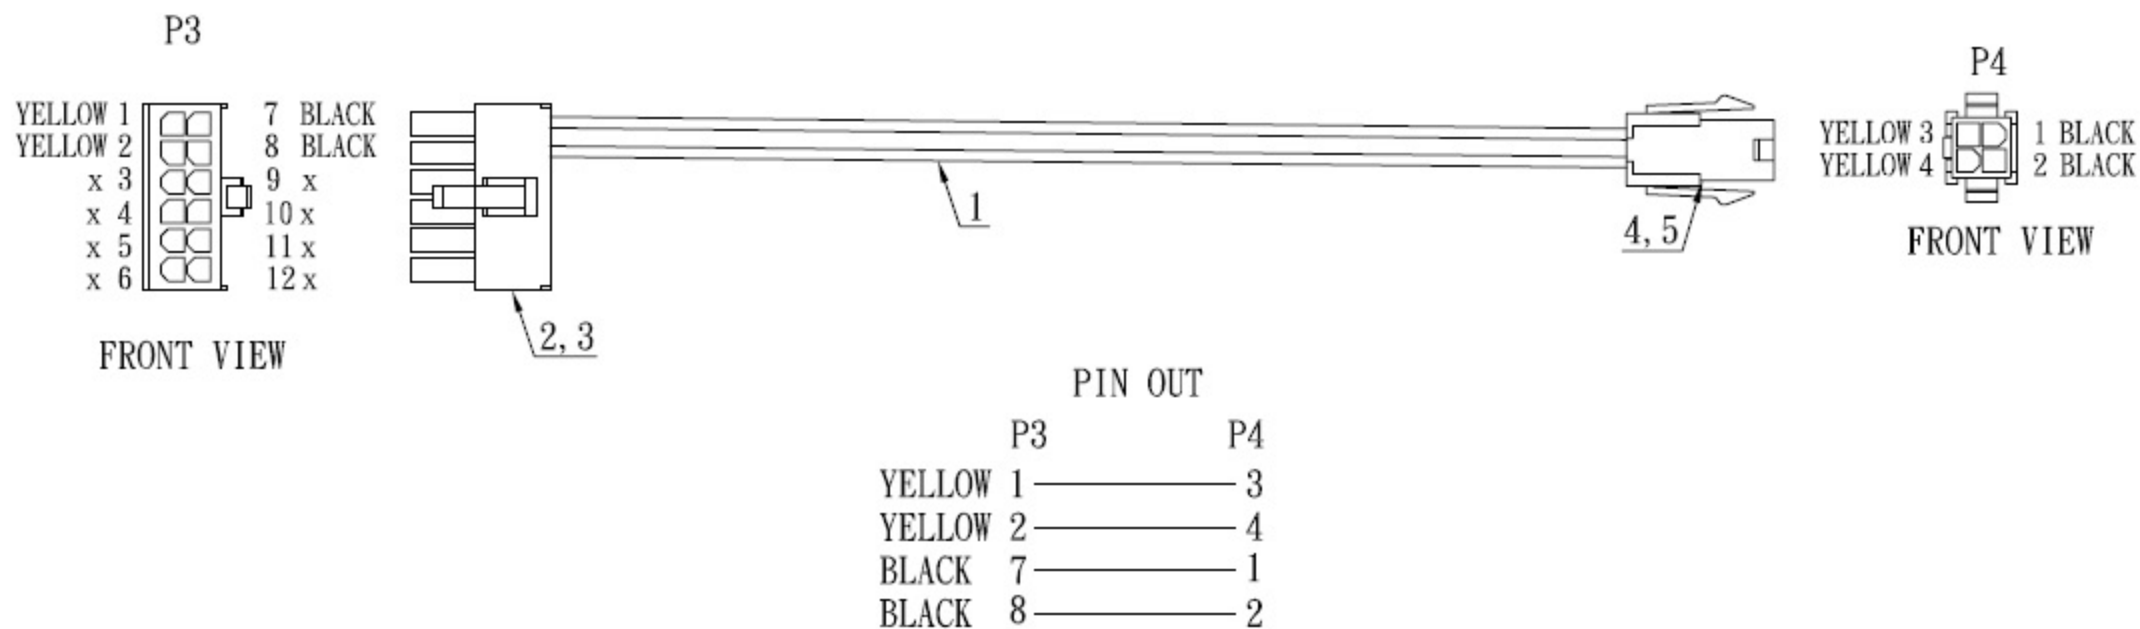

| No. | NAME | DESCRIPTION | Q' TY |
|-----|----------|--|--------|
| 1 | WIRE | UL1007#20 C=YELLOW, BLACK L=215mm | EACH 2 |
| 2 | TERMINAL | R2663-D3-F-BT | 4 |
| 3 | HOUSING | R2660-D3-12M PH:3.0mm 2x6P | 1 |
| 4 | TERMINAL | R2663-M-BT-L | 4 |
| 5 | HOUSING | R2660-4F PH:4.20mm 2x2P WITH MOUNTING EARS | 1 |



| DWG NAME | RE011-1022-6309-1 (RoHS) | CHECKED | APPROVED | SCALE: NTS | REV NO | DATE | DESCRIPTION | BY | CHECKED | WORKING STATION | |
|----------|--------------------------|------------|--------------|-------------------|--------|------|-------------|----|---------|-----------------|--|
| | | PIQI | | UNIT: mm(in.) | A | | | | | | |
| | | DRAWN NAME | DATE | CAD NO | B | | | | | | |
| | | YXF | 2008.09.02-2 | RE011-1022-6309-1 | C | | | | | | |